
GRADING TEMPLATE


* Fall from B.L. shall be a min. 5% in the first 10' and min. 2% thereafter

** Rear and Side yard swale slopes shall be a min. 2%

*** Maximum Slope on Site 25% (1 on 4)

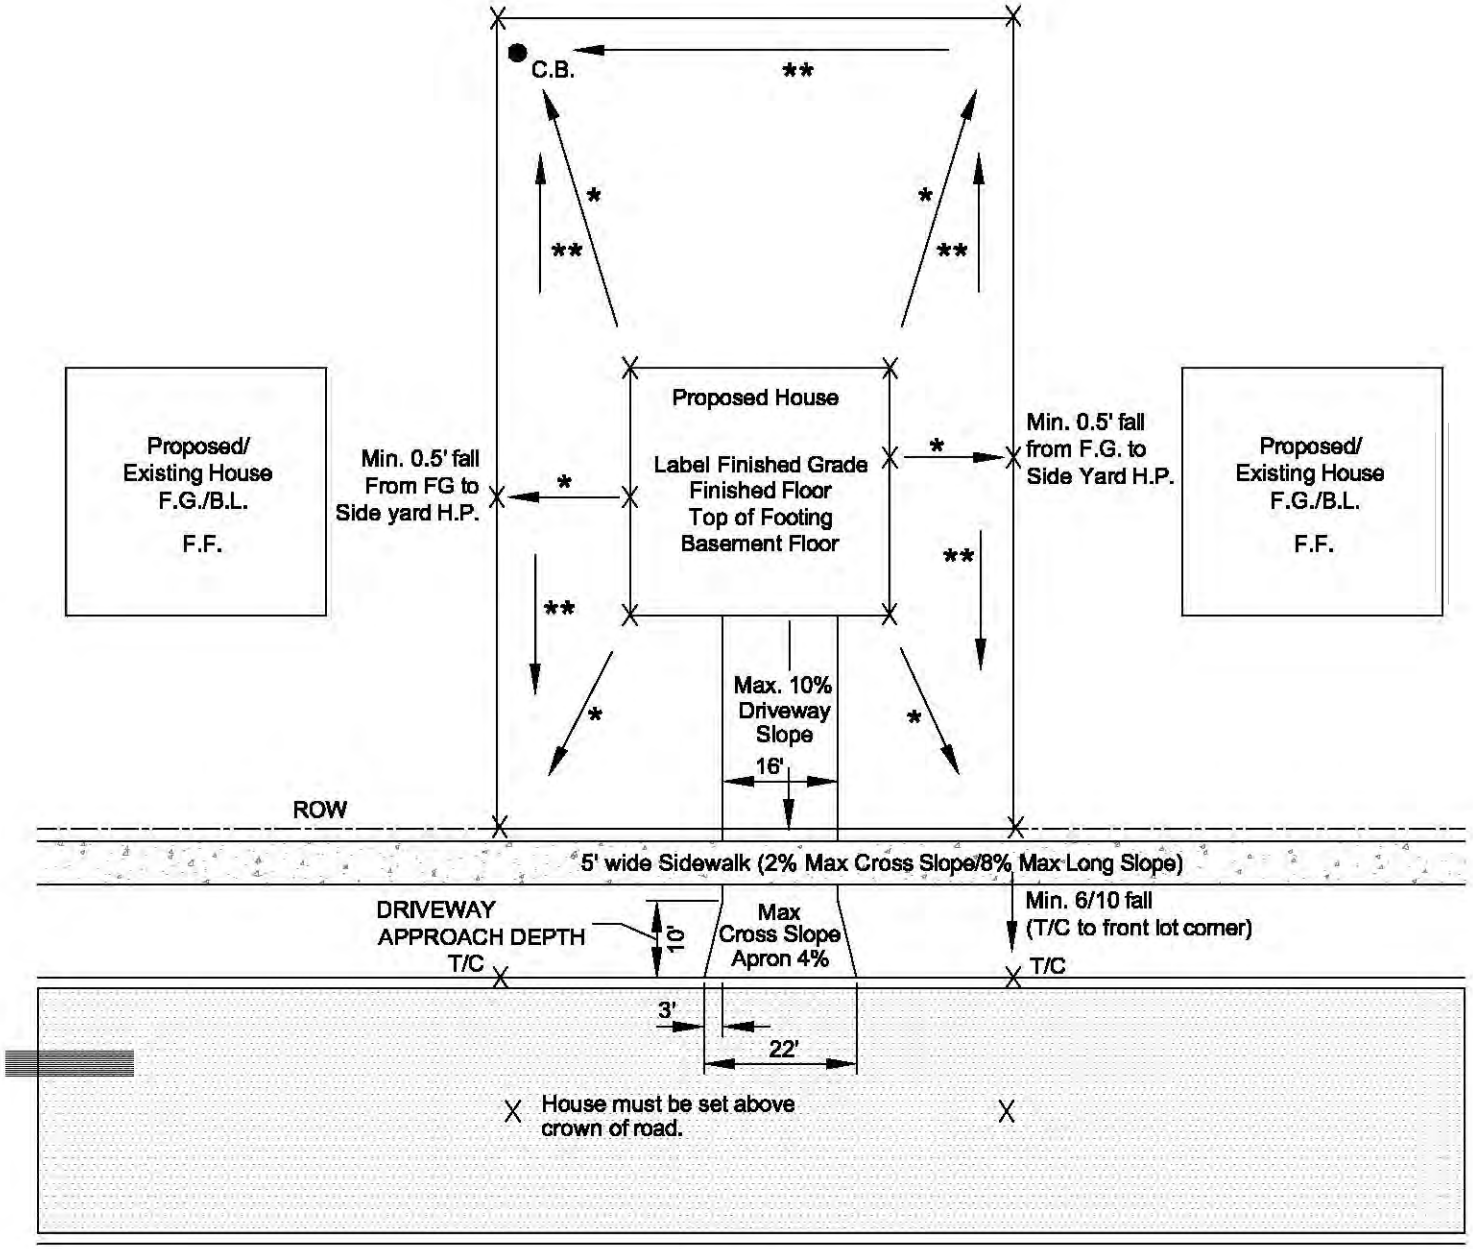

NOT TO SCALE



4" CONCRETE PAVEMENT (4000 PSI)
(6" THICK THROUGH RESIDENTIAL DRIVES AND RAMPS)

6" 21AA CRUSHED LIMESTONE PER MDOT GRADATION SPECIFICATIONS.
STONE BASE SHALL EXTEND A MIN 6" BEYOND FORMS.
NO SAND ALLOWED.

SIDEWALK CROSS-SECTION

NOT TO SCALE